

PASMA

90.5




OPERATOR'S CODE OF PRACTICE

PASMA

**Prefabricated Aluminium
Scaffolding Manufacturers Association**

**NEW EDITION PUBLISHED JANUARY 1994
(4th revision)**

**Applies only to Prefabricated Aluminium
Alloy Towers supplied by members
of P.A.S.M.A.**

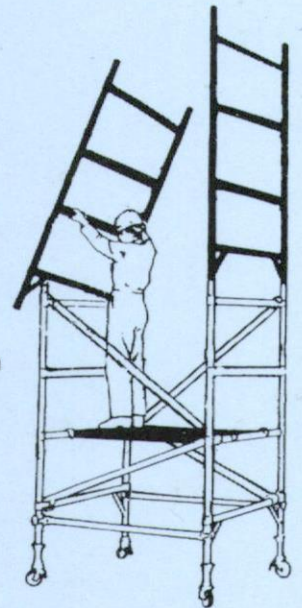

£5.00

CONTENTS

	Page		Page
1 Introduction	1	6 Safe Use of Towers	12
		General	12
2 Scope of this Code of Practice	1	Guardrails & Toeboards	12
		Platforms	12
3 Tower Components	2	Safe Loading	12
Three typical types of		Incomplete Towers	12
Prefabricated Aluminium Alloy		Moving Towers	13
Towers		Cantilever Platforms	14
		Use of Scaffold Boards &	
4 Erection and Dismantling	4	Stagings	14
Instruction Manual	4	7 Hazards	15
Type & Number of Components	4	Safety Check List	15
Ground Surface	4	Safety Check List (Cont.)	16
Castors Baseplates & Adjustable		8 Inspection	17
Legs	4	Before Erection of Tower	17
Base Section	5	Before use of Tower	17
Upper Sections	5	Before use of Tower (Cont.)	18
Braces	5	During use of Tower	18
Platforms	5	9 Care & Maintenance	19
Guardrails & Toeboards	5	Handling, Transport, Storage	19
Scaffold Couplers	6	10 Regulations, Standards &	
Means of Access	6	Exemptions	20
Independent Ladders	6	12 Training	21
Rest Platforms	6	13 List of P.A.S.M.A.	
5 Stability of Towers	7	Member Companies	22
General	7		
Height Calculations	7		
Tower with Stabilisers	7		
Tower with Outriggers	7		
Wind	8		
Wind Loads on Tower	8		
Other Horizontal Loads	8		
Vertical Eccentric Loads	8		
Outriggers & Stabilisers	9		
Sheeted Towers	9		
Tying In	9		
Use as Facade Scaffold	9		
Tie Arrangements	10		
Use of Tube & Couplers	11		
Ballast weights, Guy-ropes &			
Towers in Public Places	11		

FOURTH EDITION (Issued January 1994)

©P.A.S.M.A. 1994

Prefabricated Aluminium Scaffolding Manufacturers Association Limited

1. INTRODUCTION

P.A.S.M.A. is an association of the U.K. manufacturers and suppliers of prefabricated aluminium alloy towers. All PASMA members have their equipment approved to BS1139 Part 3 1994 (HD 1004) and therefore carry a current British Standard or other equivalent mark of approval (eg Testguard, GS mark). This is a guarantee to the user that specific standards of design and fabrication have been met which is not possible with unapproved systems.

The Health and Safety Executive have published a tower scaffold Guidance Note no GS42 which provides users with advice on the use and application of towers within the framework of the Health and Safety at Work Act and the Construction Working Places Regulations 1966. In due course we expect this Guidance Note to reflect the latest European requirements.

This fourth Edition of the PASMA guide has been written to particularly take account of the latest British and European Standard requirements, and it will supersede all previous editions and continue to provide guidance on Safety.

2. SCOPE OF THIS CODE OF PRACTICE

This PASMA Code of Practice mainly relates to free-standing access towers manufactured from prefabricated components where the principal structural material is aluminium and specifically relates to towers that have a British Standard or equivalent U.K. or European approval mark.

This type of prefabricated aluminium alloy tower system can also be assembled to form continuous facade scaffolds and special structures, such as portal frames, bridges etc, but these special structures are outside the scope of this Code of Practice and users must consult their supplier for further information.

The scope of BS1139 Part 3 1994 (HD1004) is limited to standard mobile prefabricated towers not exceeding 8m platform height externally, or 12m internally.

This PASMA document is a code of practice and should be used in conjunction with the appropriate manufacturers instruction manuals. Their instructions should be written in conformity with the proposed EN 4711, which is the European standard covering the rules and guidelines for the preparation of instruction manuals for aluminium towers.

3. TOWER COMPONENTS

3.1

The main structure comprises End Frames, diagonal and horizontal braces, adjustable legs with base plates or castor wheels. Above a certain height stabilisers or outriggers will be required. Working areas at the top or intermediate level are provided by platform units, around which will be guardrails and toeboards for safety.

3.2

Access to the platform is gained by either inclined or vertical ladders stairladders or stairways depending on whether materials are carried. The ladders can be either built into the frame structure or separate purpose-built vertical or inclined ladder units can be used (see 4.11).

The access provided depends upon the type of towers selected and will vary with different suppliers designs. See illustrations on page 3.

3.3

Horizontal, and diagonal braces will generally be identical except in length. The length and purpose of the brace may be marked clearly on it by an identifying label and/or colour coding. These braces will have a locking hook mechanism on the ends, which is used to lock onto the horizontal or vertical members of the End Frames. The braces cannot be removed until the hook mechanism is unlocked.

3.4

Platform units normally comprise an aluminium frame with two hooks at each end. Platform hooks locate over the horizontal members of the end frames of the tower and are not normally provided with locking mechanisms except to prevent wind uplift. A deck surface will be fixed to the metal frame, which will normally be of plywood, having a special anti-slip surface. Some of the platform units will usually have a hinged hatch to allow access within the tower.

Platform units are normally about 600mm (24") wide and are available in length to suit the modular length of the tower.

Platforms can be single units or two units side by side. For intermediate or landing access platforms a single unit would generally be used, but for maximum safety (ie on working platforms) two units are desirable. Single platforms should be surrounded on 3 sides (including the working face) by double guardrails and toeboarded as usual. Single width towers should be fully double guardrailed and toeboarded as usual.

3.5

The width of the basic tower is governed by the width of the end frames and typically these are available in two widths: Single Width and Double Width of approx. 0.75m and 1.3m respectively. The length of the basic tower can be varied by the length of braces and platforms. These range from 1.5m to 3.2m.

3.6

Outriggers and stabilisers may be attached to increase the EFFECTIVE BASE AREA and to improve stability (see section 5).

An outrigger is a device for use on towers which are to be moved frequently and has provision for a castor.

A stabiliser is a similar device to be used on towers that are moved less frequently and has a self aligning foot in lieu of a castor.

COMPANY	ADDRESS	PRODUCT
NSG Services Group Plc Tel: 01244 289166 Fax: 01244 280432	Parkway Deeside Industrial Park Deeside, Clwyd CH5 2NS	EIGER TOWER
UpRight Tel: (01) 2853333 Fax: (01) 2840015	Pottery Road Dun Laoire Ireland	INSTANT ZIP-UP

Applications are invited for council membership from qualifying companies and for Associate Membership, and should be addressed to the P.A.S.M.A. secretary above.

SECRETARY

PREFABRICATED ALUMINIUM
SCAFFOLD MANUFACTURERS
ASSOCIATION LTD.

P.O. BOX, 1828
WEST MERSEA
ESSEX. CO5 8HY
TEL & FAX: 01206 382666

MEMBERS

COMPANY	ADDRESS	PRODUCT
Aliscaff Limited Tel: 0181-808 5005 Fax: 0181-801 9851	Unit 2, Hotspur Industrial Estate, West Road, Tottenham London N17 0RJ	ALISCAFF
Instant Zip-Up Limited Tel: 01952 825815 Fax: 01952 825635	Audley Avenue, Newport, Shropshire TF10 7DP	INSTANT ZIP-UP RIBGRIP
Access International Limited Tel: 01264 324014 Fax: 01264 358730	South Way, Walworth Industrial Estate, Andover, Hants SP10 5AD	HI-WAY CLIMALLOY ZIG-ZAG
SGB Tel: 01403 791417 Fax: 01403 790881	Stane Street, Slinfold, Horsham, West Sussex RH13 7RD	BOSS SNAPLOK
Turner Access Limited Tel: 0141-307 1212 Fax: 0141-425 1073	65 Craigton Road, Glasgow G51 3EQ	TRADESMAN
W.C. Youngman Tel: 01403 790456 Fax: 01403 790881	Stane Street, Slinfold, Horsham, West Sussex RH13 7RD	BOSS EASI-BUILD
Deborah Services Ltd. Tel: 01924 378222 Fax: 01924 366250	10 South Parade Wakefield West Yorkshire WF1 1LS	HI-WAY CLIMALLOY ZIG-ZAG

FIG. 1

THREE TYPICAL TYPES OF PREFABRICATED ALUMINIUM ALLOY TOWERS


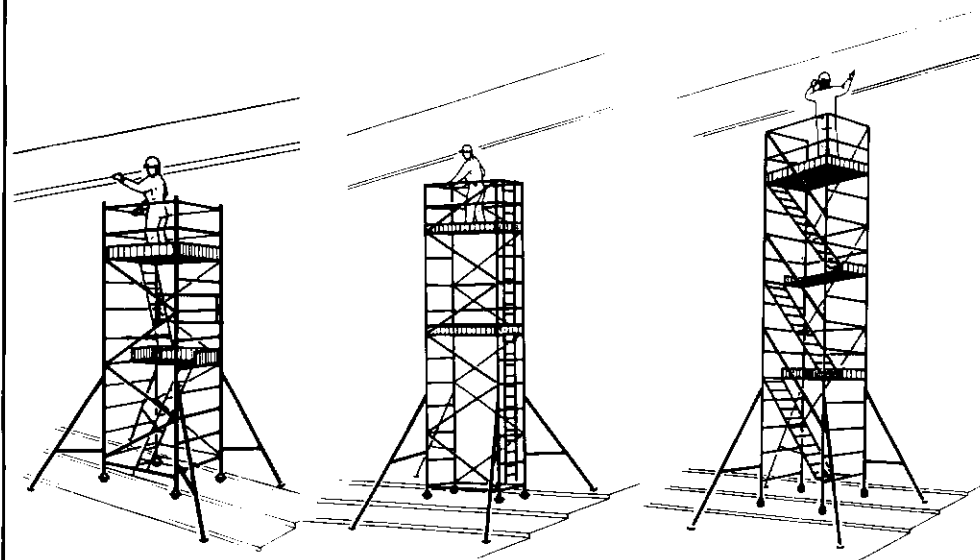


FIG. 1A

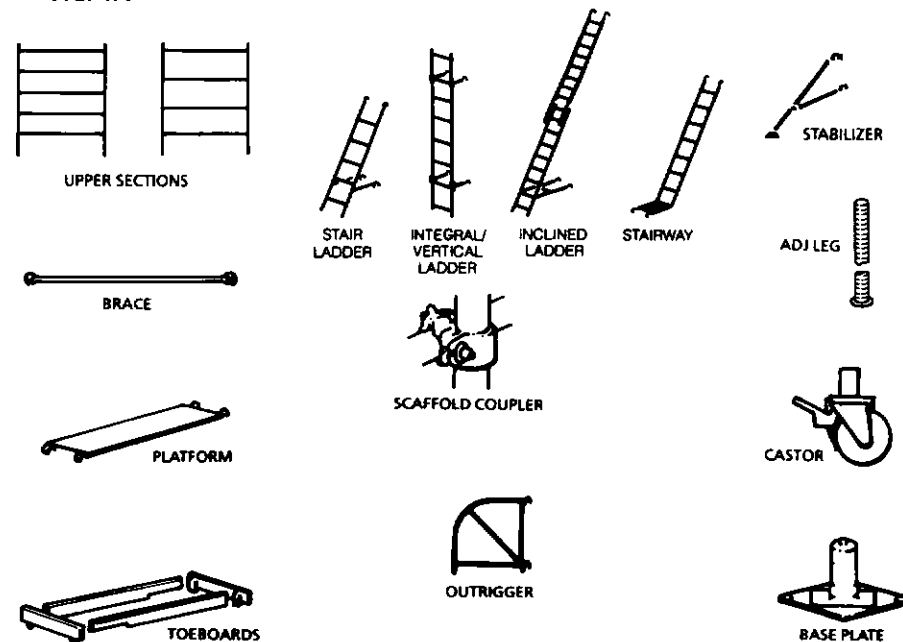

4. ERECTION AND DISMANTLING**4.1 Instruction Manuals**

All PASMA members supply comprehensive manuals on the erection/dismantling of towers which will comply with the proposed European Standard EN 4711 whether the tower is supplied on a hire or sale basis.

SUPPLIERS AND USERS SHOULD ENSURE THAT THESE MANUALS ARE AVAILABLE TO THE OPERATIVES ERECTING AND USING THE TOWER, AND TO THE PERSON SUPERVISING THE WORK. USERS SHOULD ALSO ENSURE THAT THE OPERATIVES ERECTING THE TOWER ARE COMPETENT TO DO SO BY SPECIAL TRAINING (OR ARE SUPERVISED BY SUCH A PERSON) (see training section 12). PASMA have designed a recognised certification system for this purpose.

4.2 Type and Number of Components

The type of components used for the construction of a tower must be compatible. Not only should they all be components from the same supplier, they should also be those recommended for the particular tower configuration. Suppliers usually provide a range of different types of towers and although some components are interchangeable between types, this is not always the case and unsuitable components should be rejected. Before commencing to erect the tower make sure that the correct number of components are available and never attempt to make up deficiencies by the use of alternative suppliers parts or random scaffold tubes, couplers or scaffold boards etc.

4.3 Ground Surface

Towers should be erected and used only on ground suitable for the purpose, generally with a surface of concrete, tarmacadam or similar. Where tower are on soft or uneven ground, base plates should be used instead of castors, and these should be set on boards or other decking which will provide a firm foundation. Outriggers and stabilisers should be similarly treated.

4.4 Castors, Base Plates and Adjustable Legs

Erection is usually commenced by fitting either castors or baseplates to four adjustable legs. The design includes a feature to prevent the castor or base plate from falling out of the adjustable leg. The adjustable legs are fitted into the lower ends of the columns of two end frames. A mechanism prevents the adjustable leg from falling out of the end frames. Each leg has a device to vary its extension, so that the tower can be made level on uneven or stepped surfaces.

THIS IS NOT a means of gaining additional height and the extension of the adjustable leg should be the minimum possible. Where adjustment is required beyond that for normal levelling purposes, the suppliers advice must be sought.

12 Training

Aluminium alloy towers are designed to be erected and dismantled by operatives without extensive skills and training. Provided that the erector can interpret the simple instructions in the suppliers manual and can competently check the structure when it is finished, then no problems should arise in erecting basic towers. However, PASMA recognise that increasingly more specific training in the use of this type of equipment is required. PASMA therefore sponsors a training course, operated by its member companies, whereby the would-be user can learn the essential points and safety features which ensure the safe erection and use of aluminium towers.

The course is based on a format and content agreed by all the PASMA members with their own extensive experience. Hence it has great value as a training programme, and is widely recognised by safety professionals.

A PASMA Certificate (and, if required identity card), is issued to those attending the course and passing the written and practical test. Further details can be obtained from any PASMA member company.

IF IN DOUBT – ASK YOUR SUPPLIER (LISTED OVERLEAF).

10. REGULATIONS, STANDARDS, RECOMMENDATIONS AND EXEMPTIONS

10.1

PASMA or kitemarked or equivalent aluminium alloy towers must conform to the statutory requirements of the Construction (working Places) Regulations 1966 and the current British Standard (European Harmonisation Document HD 1004). The principal points in the regulations relate to safety of the structure and the provision of guardrails and toeboards, the width of the working platforms and the use of ladders on scaffolds. Tower designs supplied by PASMA member companies will conform to all these requirements, provided the components are erected and used in accordance with the instruction manual.

10.2

Recommendations for the design and performance of aluminium alloy towers are contained in HD 1004 and British Standard 1139. Towers supplied by PASMA member companies must conform fully with these requirements and are marked with the British Standard Kitemark of Approval, Testguard German GS Mark or equivalent European accreditation bodies.

Recommendations for the safe use of aluminium towers is contained in HSE Guidance Note GS 42:1987, and prEN 4711 – Rules and Guidelines for the preparation of instruction manuals.

This PASMA code of practice is intended to satisfy the following statutory regulations, standards and recommendations applicable to prefabricated aluminium scaffold towers.

- a European Harmonisation Document HD 1004
- b HSE Tower Scaffold Guidance Note GS 42 1987
- c The Health and Safety at Work Act 1974 Section 6
- d The Construction Working Places Regulations 1966
- e British Standard 1139 Part 3:1994 (HD1004:1992)

4.5 Base Section

The base section comprising the two end frames and crossbraces, is then assembled according to the suppliers instructions. The legs should then be adjusted so that the base section is vertical and the two end frames are at the same level. It is therefore preferable that the tower be erected in the position in which it is to be first used, otherwise the tower may have to be re-levelled when it is moved into the working position. If castors are used these should now be braked. For tiered floor situations the frames can be at offset levels as recommended by the supplier. Generally these offset frames will require extra diagonal bracing which should be placed in the positions as in the suppliers manual. If stabilisers or outriggers are required they must now be securely located (See section 5).

4.6 Upper Sections

The upper sections of the tower can now be erected following the sequence in the suppliers manual. Attention must be given to the following points: End frames are connected by a spigot and socket joint with a locking mechanism which must be positively engaged. All other tower components must be fitted in the correct positional sequence – without omissions.

Lifting Components

The suppliers manual will give the recommended methods for lifting components.

4.7 Braces


Diagonal Braces, Horizontal (handrail) Braces have locking hook mechanisms which engage with either horizontal or vertical frame members. When fitted to horizontal members locking hooks must have their aperture facing downwards. When horizontal braces are fitted to verticals ensure that locking hooks have their aperture facing outboard. In all cases when fitting braces ensure that the hook mechanisms have operated correctly and that the brace is securely fixed to the frame.

4.8 Platforms

All platform deck units have hooks at each end which locate onto the horizontal members of end frames. Ensure that these are properly positioned and that the platform sits firmly and squarely in place. If platforms have an access hatch, make sure that this is correctly orientated with the hinge outboard. The windlock device should be engaged. Platform decks must be installed at least every 4 metres in height.

4.9 Guardrails and Toeboards

Platforms must be fitted with guardrails and toeboards and care should be taken to see that these are correctly fitted in accordance with the suppliers instructions, which will comply with the height requirements of BS1139 Part 3

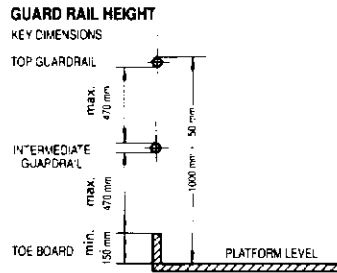

1994 (HD1004), which specify:

Top guardrail height 1000mm +/- 50mm above platform level

Intermediate Guardrail 470mm max space between underside of Intermediate Guardrail and toeboard level.

Minimum toeboard height: 150mm

4.10 Scaffold Couplers.

Most PASMA towers have tubes of larger diameter than standard scaffold tube. Standard scaffold couplers are not therefore suitable for coupling to PASMA towers. If steel or aluminium scaffold tubes are connected to tower structures, possibly to provide a stabilising tie the user should ensure that the coupler used is suitable, ie one that will accept the two different sizes of tube. These are available from PASMA members.

4.11 Means of Access

Access to the platform must be provided by the following:

	INCLINATION	CLEAR WIDTH
Integral/vertical Ladders	-	280mm
Stairladders	35-55 deg.	280mm
Inclined Ladders	60-75 deg.	280mm
Stairways	35-55 deg.	400mm

These should be erected as shown in the suppliers instructions. If materials are to be carried or frequent vertical movement required, an inclined Stairway should be used.

EXTERNAL LADDERS MUST NEVER BE USED WITH ALUMINIUM TOWERS.

Access to or through fully decked platform levels must be via a hatch (min. size 400 x 600mm which must be capable of being secured in the closed position.

The first step onto the tower should not exceed 400mm, unless the first step is a platform, when it should not exceed 600mm.

4.12 Independent Ladders

Only specialised versions of independent ladders should be used, which will have been designed specifically for the purpose.

4.13 Rest Platforms

Where the vertical distance between platforms exceeds 4 metres (13ft) a rest platform with double guardrails and toeboards must be provided. If the tower is unable to comply with the dimensions shown in 4.9 above a special guardrail frame should be employed to obtain the correct guardrail level.

9. CARE AND MAINTENANCE

9.1

Those responsible for the care and maintenance of aluminium alloy towers should regularly check the inspection points outlined in section 8. Additionally inspection should periodically be made of all tower components, joints, rivets and locking devices. Any defects should be made good before the component is used further. Very few parts in aluminium alloy towers need lubrication but if the supplier recommends it, the mechanism for locking hooks, adjustable legs and castors should be lubricated with a suitable lubricant.

9.2 WARNING

REPAIRS SHOULD ONLY BE CARRIED OUT BY THE SUPPLIER OR OTHER COMPETENT PERSON APPROVED BY THE SUPPLIER.

Platforms should not be painted or treated subsequent to manufacture in a way which may conceal defects. Any instruction signs should be checked and replaced as necessary.

9.3 Handling, Transport and Storage

The life of aluminium alloy towers will be increased if proper care is taken of them during handling, erection, transportation and storage. Before storage components should be cleaned. Any concrete or corrosive substance should be removed.

Proper stacking will reduce any damage, and will make identification of the components easier for re-issue.

Similarly during transportation equipment should be properly stacked on vehicles. Space can be saved by systematically placing braces, platforms stairways etc in available space within vertically stacked frames.

- Check outriggers or stabilisers are correctly positioned and secured, as close as possible to the underside of the castings or cross-member.
- Check that all baseplates or castor wheels are fully in contact with the ground including those on outriggers. Stabiliser feet should rest firmly on the ground. All castors and leg adjustment devices are secured.
- Check that all the spigot and socket joint locks holding the frames together are secured.
- Check that all the bracing members have been located exactly in accordance with the instruction in the suppliers manual.
- Check that all windlock clips on platforms are in position.
- Check that all guardrails and toeboards are in position as required.
- Check that all access stairways and ladders are in position and are firmly located.

8.3 During Use of The Tower

During use, the tower should be kept in good working order. For ongoing use, a competent person should inspect the tower weekly (in accordance with Safety Regulations) to see that the structure is still safe to use. Should parts become damaged they should be replaced before the tower is used again.

5. STABILITY OF TOWERS

5.1 General

The major reason for selecting aluminium alloy towers to provide access is the lightness of the components and the consequent ease of assembly compared to the heavier sections of steel scaffold structures. In mobile form aluminium towers are easy to move from point to point, but the lightness of the structure means that care has to be taken to ensure the stability of tower. The manual the supplier provides, will show the safe height to which various tower configurations can be erected, and will give information on the use of stabilisers and outriggers to increase the stability of high towers. If these instructions are observed, aluminium alloy towers provide a stable and firm work platform for a wide variety of applications.

5.2 Height Calculations (Height to Base Ratio)

It is no longer appropriate to apply the simple rule of thumb measure of 3 x minimum base dimension for external use (or 3.5 internal) as the tower structures perform in different ways in tests and calculations. For this purpose you should refer to the suppliers assembly instructions which will show the quantities of material required for each height of tower, and the stabiliser requirements. However, as a general rule, stabilisers or outriggers will be required once a tower has been built beyond its first frame level.

The illustration shows the optimum positions for stabilisers – for fuller information contact your supplier.

FIG. 3 TOWER WITH OUTRIGGERS


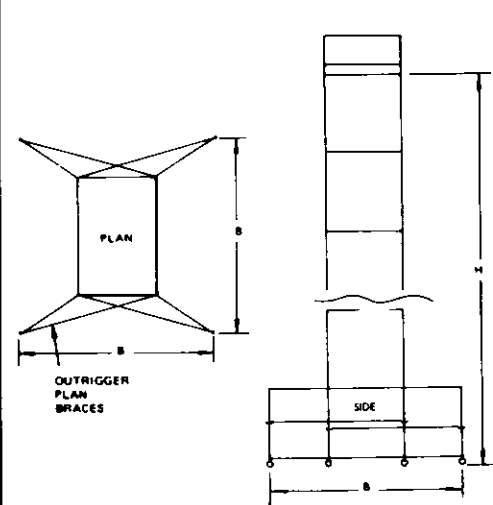


FIG. 4 TOWER WITH STABILISERS

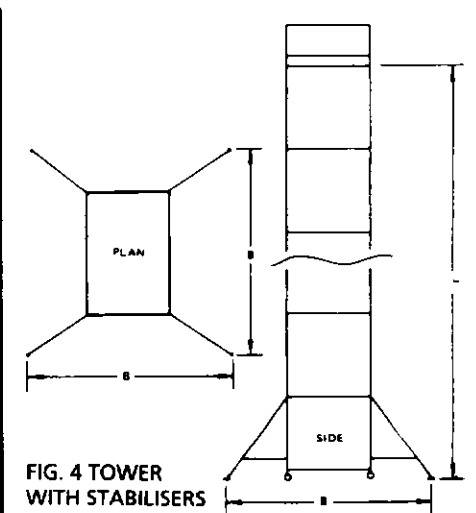

5.3 WIND

Information about the effect of wind on towers and the safe conditions in which they can be used is contained in the following section of this PASMA Code of Practice.

Be cautious about the use of towers in open ended buildings, such as hangars or unclad buildings, as the wind forces in such locations can often be greater than if the towers are used outside the building, due to the funnelling effect of the wind.

5.4 Wind Loads on the Tower (Free Standing Towers)

Wind imposes a horizontal load on the tower tending to overturn it. In normal safe working conditions this tendency to overturn is counteracted by the self-weight of the tower, and the stabilising effect of the outriggers or stabilisers. The new BS1139 Part 3 1994 (HD1004) states that towers must be stable in a freestanding condition in a wind pressure that equates to 28 mph or Beaufort force 6. If the wind speed should exceed 17mph you should cease to work upon the tower. **If the wind speed reaches 25mph the tower should be tied in to a rigid structure, and if it is likely to reach 40mph, the tower should be dismantled.**

Towers erected in accordance with this code are safe to be used in winds up to these speeds when the specific recommendations of the supplier are followed.

5.5 Other Horizontal Loads

Apart from wind loads, other horizontal loads can act on the tower. These are mainly caused by the actions of operatives working on the tower. For example, when using hand tools, such as a drill, pushing on the drill causes an equal and opposite force on the tower. Such forces should be avoided as much as possible and in no circumstances should they exceed 20kg (44lb) on free standing towers.

It is hazardous and illegal to move towers by pulling them along from the platform. Towers must only be moved by application of manual effort at or near the base and there should be neither men nor materials on the tower during the moving operation (See section 6.6m – moving towers).

5.6 Vertical Eccentric Loads (lifting Material etc.)

Any vertical load outside the area of the tower can be hazardous. For example, heavy materials hoisted outside the effective base area of the tower have a tendency to overturn the tower particularly if no outriggers or stabilisers are fitted as can be the case with towers of lower height.

Loads must be hoisted within the EFFECTIVE BASE AREA of the tower (ie within the area bounded by the tower or stabilisers/outriggers where fitted. The advice of the suppliers must be sought about hoisting loads to ensure safe and stable use of the tower.

8 INSPECTION**8.1 Before Erection of Tower**

Ensure that the operatives erecting the tower have received proper training to a certificated standard.

Before using a tower, all components should be checked to see that they are in good condition, are compatible (from the same manufacturer) and that all joints are sound.

Castors should be inserted and checked to see that in each case the castor housing and wheel/tyre is not damaged, that the wheel rotates readily, that the castor swivel rotates effectively and that the brake functions properly.

Adjustable legs should be checked to see that they are not bent, or the thread damaged. All threads should be clean and free from debris. The adjustable leg device should be inserted and removed to see that the securing device operates effectively.

Frames should be checked to see that the members are straight and that joints and welds are undamaged. They should be free of extraneous material such as concrete. Spigots should be straight and parallel with the axis of the column tube and the device for locking frames together should be checked to see that it is functioning correctly.

Similarly braces, stairways and ladders should be checked to see that they are straight and undamaged and locking hook mechanisms should be checked to see that they are functioning correctly.

Platforms should be checked to see that they are undamaged and that the frames are square and true. Plywood decks should not be split or warped and should be firmly fixed to the frames. Where toeboards incorporate clips or fittings these should be undamaged and firmly fixed to the toeboard. Ancillary parts, such as outriggers and stabilisers should be checked for damage and effective functioning of hooks and couplers. Any labels should be intact and legible.

8.2 Before Use of Tower

Whilst the tower is being erected, the following checks should be made as the erection proceeds:

- Check that it is vertical and square and that the horizontal braces and platforms are horizontal.

SAFETY CHECK LIST (Continued)

- 17) Do not move the tower by any mechanical means.
- 18) Do ensure the ground is clear of obstructions, potholes, ducts etc.
- 19) Do ensure the tower is clear of overhead obstructions.
- 20) Do see that bracing members are fitted in accordance with instructions.
- 21) Do fit guardrails and toeboards, which prevent men or materials falling from the platforms.
- 22) Do be careful of strong horizontal forces at working platform level, such as percussion tools etc.
- 23) Do not lift materials or equipment outside the base area of the tower.
- 24) Do not use the tower in adverse weather conditions.
- 25) Do inspect before each use.
- 26) Do not use a mobile tower when the castor wheels have not been locked.
- 27) Do not exceed the Safe Working Load.
- 28) Do not use sheeting around the tower.
- 29) Do not extend the height of the top platform by the use of ladders, boxes or other devices.
- 30) Do not climb from the tower into a nearby building, or vice versa.
- 31) Do not climb up the rungs of the frames unless they are of the accepted safe spacings or ignore other recommended access procedures.
- 32) Do not use a tower in the vicinity of overhead electrical lines. They are not normally insulated, are dangerous and you should keep well clear.
- 33) Do take precautions in industrial areas, housing estates, public places etc. like fencing the base of the tower to prevent children or vandals from climbing the tower and vehicles colliding with the tower.
- 34) Do fix a warning notice if the tower is to be left incomplete.

5.7 Outriggers and Stabilisers

Outriggers or stabilisers increase the EFFECTIVE BASE DIMENSION of the tower and must always be fitted when required by the suppliers instruction manual.

THE SUPPLIERS INSTRUCTIONS MANUAL WILL SHOW WHEN OUTRIGGERS OR STABILISERS SHOULD BE FITTED.

5.8 Sheeted Towers

On occasions it is necessary to enclose the frame of the tower with some form of sheeting. This greatly increases the effect of wind on the tower thus reducing the stability. This will mean that such towers must be tied in at all times and the advice of the supplier should be sought.

5.9 Tying-in

Aluminium alloy towers are supplied as free-standing units for heights to the working platform of 12.0m and some suppliers provide special towers that are free standing for up to 16m. Towers above these heights where the optimum base dimensions cannot be constructed, will have to be rigidly tied into adjacent structure and the advice of the supplier should be sought.

Tying-in is normally achieved with aluminium or steel tube and compatible couplers, but the advice of your supplier must be sought.


It is safe practice to tie in towers of all heights wherever possible. However where towers are left unattended or are to be located in particularly exposed conditions, stability will almost certainly be affected by wind forces. In these circumstances ensure that the tower is adequately tied in or restrained from blowing over and that the platforms are securely fixed, or alternatively the tower dismantled.

5.10 Use as Facade Scaffolds


These are outside of the scope of this document and HD1004 and should only to be erected to the manufacturers instructions and the recommendation of BS5973:1993 or HD1000.

TIE ARRANGEMENTS


RING BOLT & ANCHOR TIE

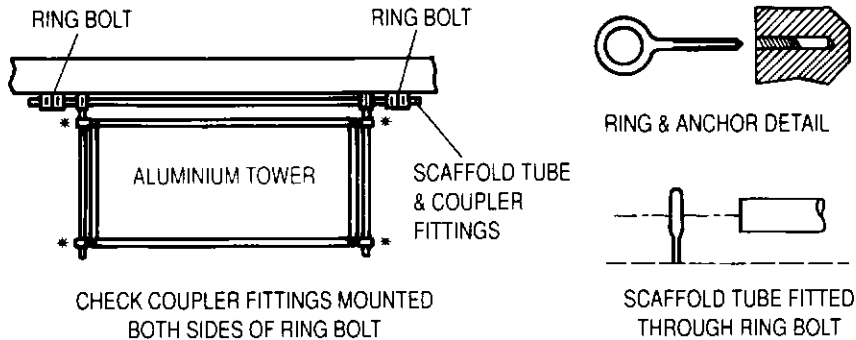

THROUGH TIE

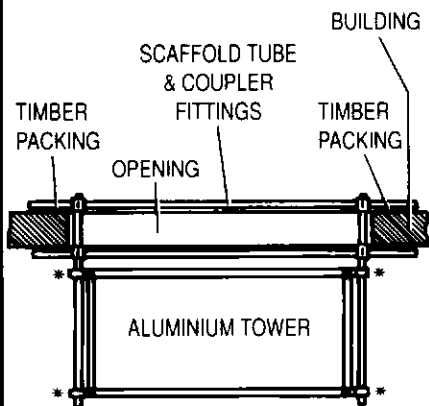

REVEAL TIE

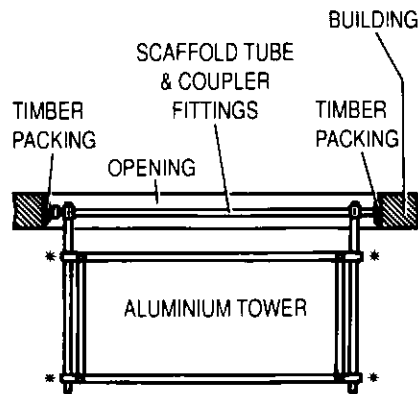

A maximum of 50% of ties should be reveal ties, unless specially designed. Because reveal ties depend on the timber packing for their anchorage, they should be checked frequently for their tightness.

*Ensure use of correct coupler fitting between scaffold tube (48.3mm diameter) and aluminium tower tube (50.8mm diameter)

7. HAZARDS

Accidents are normally the result of carelessness or failure to observe good working practice. With aluminium towers accidents can be caused by not following common sense procedures:

SAFETY CHECK LIST

7.1

- 1) Do ensure that the suppliers manual is on site and has been read and understood.
- 2) Do ensure that all the components are there, and of the same make.
- 3) Do avoid using damaged, incorrect or incompatible components.
- 4) Do check that all components are working properly.
- 5) Do not build to a height greater than the effective base dimension permits.
- 6) Do not erect on ground incapable of supporting the tower.
- 7) Do check that the ground is level, and unobstructed.
- 8) Do check that castors are locked.
- 9) Do use outriggers or stabilisers when required.
- 10) Do not use the adjustable legs to gain additional height.
- 11) Do secure interlock clips on the frames.
- 12) Do not use or move the tower on sloping or obstructed surfaces, without attention to vertical alignment and stability.
- 13) Do not use a tower which is not vertical.
- 14) Do tie Towers into a building or adjacent structure when they should be.
- 15) Do not move the tower carelessly – by pulling it along at working platform level.
- 16) Do not move the tower with men or materials on the structure.

6.7 Cantilever Platforms

Cantilever platforms can be attached to towers. Such towers must be erected in accordance with the suppliers instructions. Never attempt to make cantilever platforms by impromptu methods chosen on site. If these towers are mobile they will have less stability unless ballasted and designed correctly and greater care must be taken when moving them.

They will have a restricted safe working load based on a minimum 3:1 factor of safety.

6.8 Use of Scaffold Boards and Stagings

Do not make up deck areas for the tower by using standard scaffold boards. However it is sometimes useful to be able to bridge between two adjacent towers with proprietary staging units. If this is done, care should be taken to see that the towers are effectively stabilised and prevented from moving. The staging should be firmly supported on a load bearing part of the tower and prevented from moving during use – a minimum of 600mm oversail on either end support should be provided. If the unit is purpose-designed with integral hooks for attachment to the tubular transom, this oversail is not required. Guardrails and toeboards must be provided to stagings.

Care should be taken when using stagings that the effective safe working load on the tower and stability requirements are complied with, and that working platform widths regulations of 600mm minimum width are complied with which will often require a minimum of two staging units. If in doubt consult your supplier.

Use of Tube and Couplers.

The advice of the supplier should be sought to advise on suitable methods of abutting towers especially where buildings have large glazed or clad faces, or when used in gangways against high racking.

5.11 Ballast Weights, Guy Ropes and Ground Anchors

Where additional stability is required, but cannot be achieved by tying into a rigid structure then it is possible to obtain stability by the use of ballast weights, guy ropes or ground anchors. Ballast must be of solid materials (ie no sand or water) and must be securely attached to the tower structure.

Ballast weights placed on to the base of the structure will increase tower self-weight, thereby increasing stability. A competent person or your supplier should specify the correct amount of ballast weight and care should be taken to see that the total safe load on the structure, and particularly on the castors, is not exceeded.

It is inadvisable to use guy ropes for stability unless under specialist direction.

The tower can be secured to the ground by ground anchors, anchor bolts or spikes. Anchors should be of adequate strength and the method of attachment to the tower must be as specified by the supplier.

5.12 Towers in Public Places

When towers are left erected in public places, or where vandals can gain access to the towers, it is advisable to provide security fencing around the tower base to a suitable height to prevent access, and tie in whenever possible.

In certain locations, a pavement licence may be required from the local authority, which may impose special conditions such as the use of pavement frames, lighting, etc.

6. SAFE USE OF TOWERS

6.1 GENERAL

Aluminium alloy towers provide a safe and effective working platform, provided that certain simple rules are observed.

6.2 Guardrails and Toeboards

Statutory regulations require that all platforms are provided with guardrails and toeboards. Your tower supplier will have made available suitable guardrails and toeboards which satisfy these requirements and they must be used at all times and they must be positioned in accordance with the instructions in the instruction manual. Do not be tempted to leave out guardrails/toeboards to give easier access for working.

6.3 Platforms

The platforms supplied with aluminium alloy towers are specially designed for the purpose and locate securely on the frame of the tower. Ensure that all hooks are properly engaged with their supports and see that the platforms are level and firmly seated.

6.4 Safe Loading

The suppliers instruction manual will detail the maximum loads that the tower can support. Generally speaking they will show the Safe Working Load that can be supported on any deck and the safe working load that can be supported by the tower as a whole (ie the sum of the working loads from several different decks together with the tower self weight). The castors must have their safe working load clearly stamped on them. It is recommended that a notice be exhibited at the base of the tower, showing the safe working load, so that all personnel who use the tower are aware of its safe capacity.

The self weight of the tower will affect the capacity so taller structures (ie over 12 metres) may have a restricted loading – refer to your supplier.

6.5 Incomplete Towers

When towers are left in an incomplete state, a notice should be displayed to announce the fact. This notice should read:

**DANGER
INCOMPLETE SCAFFOLD
NOT TO BE USED**

6.6 Moving Towers

Towers must never be moved with men or materials anywhere on the tower and must only be moved by applying manual force at or near the base of the tower. Never move towers with powered vehicles. Never move towers in high wind conditions. Take care tower is clear of overhead obstructions, particularly electric cables.

If a tower has to be suspended the supplier should be consulted before this is done.

It is preferable to use outriggers rather than stabilisers if a tower has to be moved frequently.

ENSURE ANY HOLES, DUCTS, PITS OR GRATING ARE SECURELY COVERED.

MOVING TOWERS

